

WALL LEGEND:


- 1-HR PARTITION WALL
- 2-HR PARTITION WALL
- NON-RATED PARTITION WALL WITH ACoust. INSUL. WHERE NOTED
- NON-RATED PARTITION WALL
- STEEL E SHIELDED PARTITION
- LEAD SHIELDED PARTITION
- 1-HR RATED CORRIDOR/ROOM (TUNNEL TYPE)
- EXISTING PARTITIONS & COLUMNS (SCREENED OR DASHED @1/8" PLANS)
- EXISTING PARTITIONS & COLUMNS (POUCHED @1/4" PLANS OR DETAILS)
- EXIST'G PARTITION TO BE REMOVED WHERE NOTED
- NEW WALL

REFERENCE SYMBOLS:

- ROOM NUMBER
- DOOR TYPE AND HARDWARE NUMBER
- WINDOW TYPE
- LOUVER TYPE
- EQUIPMENT NUMBER
- FLOOR FINISH
- CEILING FINISH
- BASE FINISH
- CABINET TYPE ON FLR. PLANS AND ELEVATIONS
- WALL CABINET
- EXISTING ITEM
- NEW ITEM
- RELOCATED EXISTING ITEM
- SMOKE PARTITION (1-HOUR MINIMUM)
- PANIC DOOR HARDWARE

F.E.C. : 10 LB DRY CHEMICAL FIRE EXTINGUISHER CABINET (SEMI-RECESSED)
F.E.C. : 10 LB DRY CHEMICAL FIRE EXTINGUISHER CABINET (SURFACE)

- NOTES:**
- ALL RATED DOORS TO BE POSITIVE LATCHING
"LABEL" SHALL MEAN "ASSEMBLY" AS DEFINED IN SECTION 4308(B) (BC 1079 ALL 90-60 & 20 MIN RATED ASSEMBLIES SHALL BE PROVIDED WITH APPROVED CASING MATERIAL SO INSTALLED TO PROVIDE A SEAL WHERE THE DOOR MEETS THE STOP ON BOTH SIDES AND ACROSS THE TOP. (CBC 5105 43-210)
 - POST-OP/PRE-OP: PATIENT CHANGE AREA TO OCCUR WITHIN THEIR RESPECTIVE CLUBCLE STATIONS. PERSONAL CLOTHING SHALL ACCOMPANY GURNEY WITH PATIENT.
 - FIELD VERIFY F.E.C. LOCATION WITH 75'-0" MAX TRAVELING DISTANCE FROM ANY POINT.

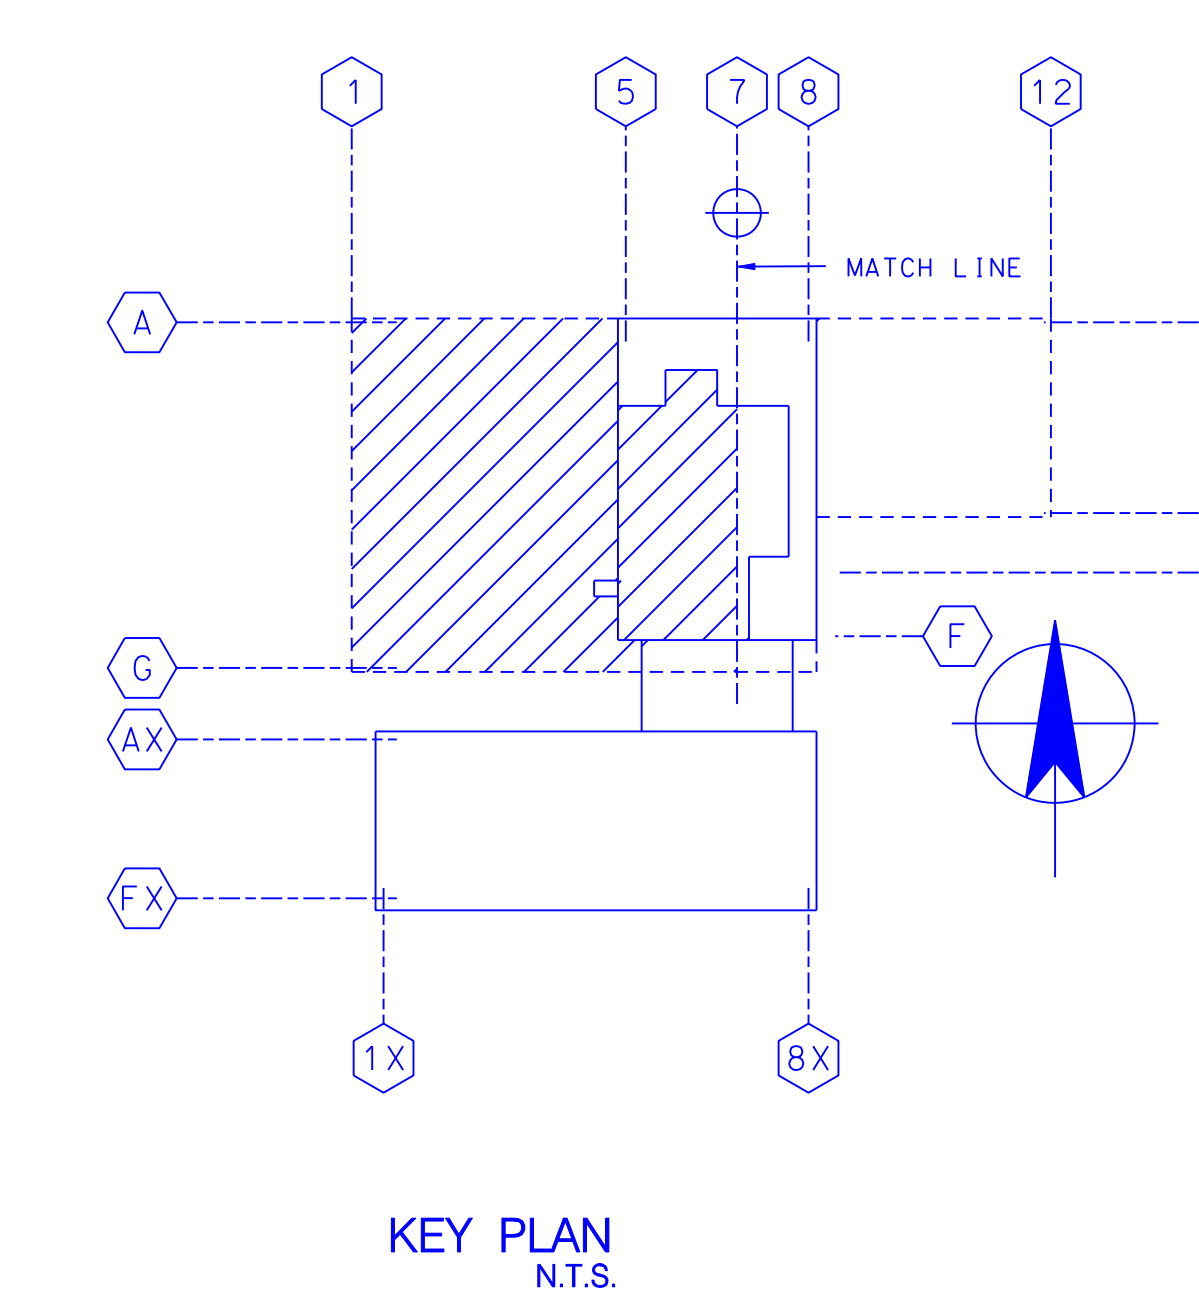

- 1. THE FOLLOWING PROTECTION FEATURES ARE TO BE REQUIRED FOR NURSES' STATIONS SUBJECT TO THIS MEMORANDUM:**
- A. IN NEW FACILITIES, THE REQUIRED SPRINKLER PROTECTION SHALL BE DESIGNED SO THAT SPRINKLER HEADS ARE LOCATED DIRECTLY OVER THE NURSES' STATION, ALSO A SMOKE DETECTOR, INTERCONNECTED TO THE FIRE ALARM SYSTEM AND LOCATED WITHIN THE NURSES' STATION SHALL BE PROVIDED.
 - B. IN EXISTING FACILITIES NOT PROTECTED BY AUTOMATIC SPRINKLERS, A SINGLE STATION SMOKE DETECTOR SHALL BE INSTALLED OVER THE NURSES' STATION WHEN BOTH REFRIGERATOR (55) AND FILE CABINET (55) ARE INSTALLED. AUTOMATIC SPRINKLERS LOCATED DIRECTLY OVER THE NURSES' STATION AND PIPED OFF THE DOMESTIC WATER SUPPLY SHALL BE INSTALLED WHEN BOTH A CRYO AND PAPER ARE INSTALLED. WHEN A PAPER OR PAPER AND EITHER A REFRIGERATOR (55) OR FILE CABINET (55) ARE INSTALLED, AUTOMATIC SPRINKLERS AS SET ABOVE SHALL BE PROVIDED.
 - C. IN EXISTING FACILITIES WHICH ARE PROTECTED BY AUTOMATIC SPRINKLERS AND A SMOKE DETECTION SYSTEM WHICH COVERS AT LEAST THE CORRIDORS, THE FACILITY MUST COMPLY WITH THE LIMITATIONS SET FORTH IN 1A THROUGH F.
 - D. IN EXISTING FACILITIES WITH A SMOKE DETECTION SYSTEM WHICH COVERS AT LEAST THE CORRIDORS ON THE SAME FLOOR AS THE NURSES' STATION, AUTOMATIC SPRINKLERS SHALL BE PROVIDED OVER BOTH A CRYO AND PAPER ARE INSTALLED. SPRINKLERS SHALL BE PROVIDED AT ALL NURSES' STATIONS. THESE CONTAINERS SHALL BE OF NON-COMBUSTIBLE MATERIALS OR SHALL BE OF A TYPE APPROVED BY THE STATE FIRE MARSHAL.
 - E. TRASH CONTAINERS SHALL BE PROVIDED AT ALL NURSES' STATIONS. THESE CONTAINERS SHALL BE OF NON-COMBUSTIBLE MATERIALS OR SHALL BE OF A TYPE APPROVED BY THE STATE FIRE MARSHAL.
- IT WILL CONTINUE TO BE THE POLICY OF THE OFFICE OF THE STATE FIRE MARSHAL TO BE AWARE AND CONCERNED WITH INTRUSIONS INTO REQUIRED EXITS, AND, IT IS NOT THE INTENT OF THIS MEMORANDUM TO DISREGARD THE NECESSITY OF EXITS TO MENA CONVENIENCE OF PATIENT CARE. RATHER, WE RECOGNIZE THERE ARE CONDITIONS OF MEDICAL NECESSITY AND A CONTINUING EVOLUTION IN MEDICAL CARE FOR PATIENTS IN A HOSPITAL ENVIRONMENT. THE SITUATIONS WHICH ARE DELINEATED HEREIN ARE DEEMED TO PROVIDE EQUIVALENT PROTECTION.**
- NURSES STATION GUIDELINES**
- A. A MAXIMUM OF ONE (1) FISH-BONE OR TWO (2) DIAMOND METAL FILE CABINETS FOR THE STORAGE OF PATIENT RECORDS AND BLANK FORMS.
 - B. FORMS AND OTHER PAPER SUPPLIES OTHER THAN THOSE NEEDED FOR THE DAY'S ACTIVITIES SHALL BE STORED IN THE METAL FILE CABINETS (55). BOOKS OR PAPER SUPPLIES SHALL NOT BE STORED IN THE OPEN AREA OF THE NURSES' STATION.
 - C. A MAXIMUM OF TWO (2) UNDERCOUNTER REFRIGERATORS OR ONE (1) UPRIGHT REFRIGERATOR LIMITED TO THE STORAGE OF PATIENT RECORDS OR PATIENT FOOD REQUIRING REFRIGERATION. THE REFRIGERATORS SHALL BE OF RECENT MANUFACTURE AND SHALL BE IN GOOD OPERATION BEING FROM THE PATIENT REFRIGERANT.
 - D. A MAXIMUM OF TWO (2) COMPUTER PRINTERS WITH THEIR INTRINSIC PAPER SUPPLIES.
 - E. 1. UNLIMITED QUANTITY OF COMPUTER MONITOR REFRIGERATORS.
2. UNLIMITED QUANTITY OF COMPUTER VIEWING SCREENS (CRT'S).
3. UNLIMITED QUANTITY OF ELECTRONIC WAITING DEVICES.
 - F. CHAIRS SHALL BE PROVIDED IN ALL NURSES' STATIONS, THE QUALITY MAY BE SUFFICIENT TO ACCOMMODATE THE NEED, ANY UNREGISTERED CHAIRS SHALL HAVE FIRE RESISTANT PADDING AND COVERINGS.
 - G. REFRIGERATED HOLDING EQUIPMENT OR SIMILAR EQUIPMENT WILL NOT BE PERMITTED IN CORRIDORS.